
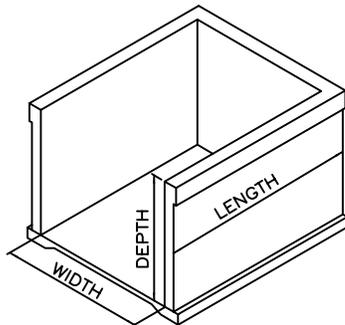


REPRODUCED WITH PERMISSION FROM:  
 Concrete Manure Storages Handbook,  
 MWPS-36  
 1st EDITION, 1994  
 © MIDWEST PLAN SERVICE  
 AMES, IA 50011-3080

- NOTES:  
 1- CONCRETE COMPRESSIVE STRENGTH,  $f'_c$ , SHALL BE 4,000 PSI.  
 2- REINFORCING STEEL SHALL BE GRADE 60.  
 3- CONCRETE COVER OVER REINFORCING STEEL SHALL BE 2" CLEAR. WHEN FORMED AGAINST EARTH, COVER SHALL BE 3" CLEAR.  
 4- FOR ADDITIONAL DETAILS, SEE SHEET \_\_\_.

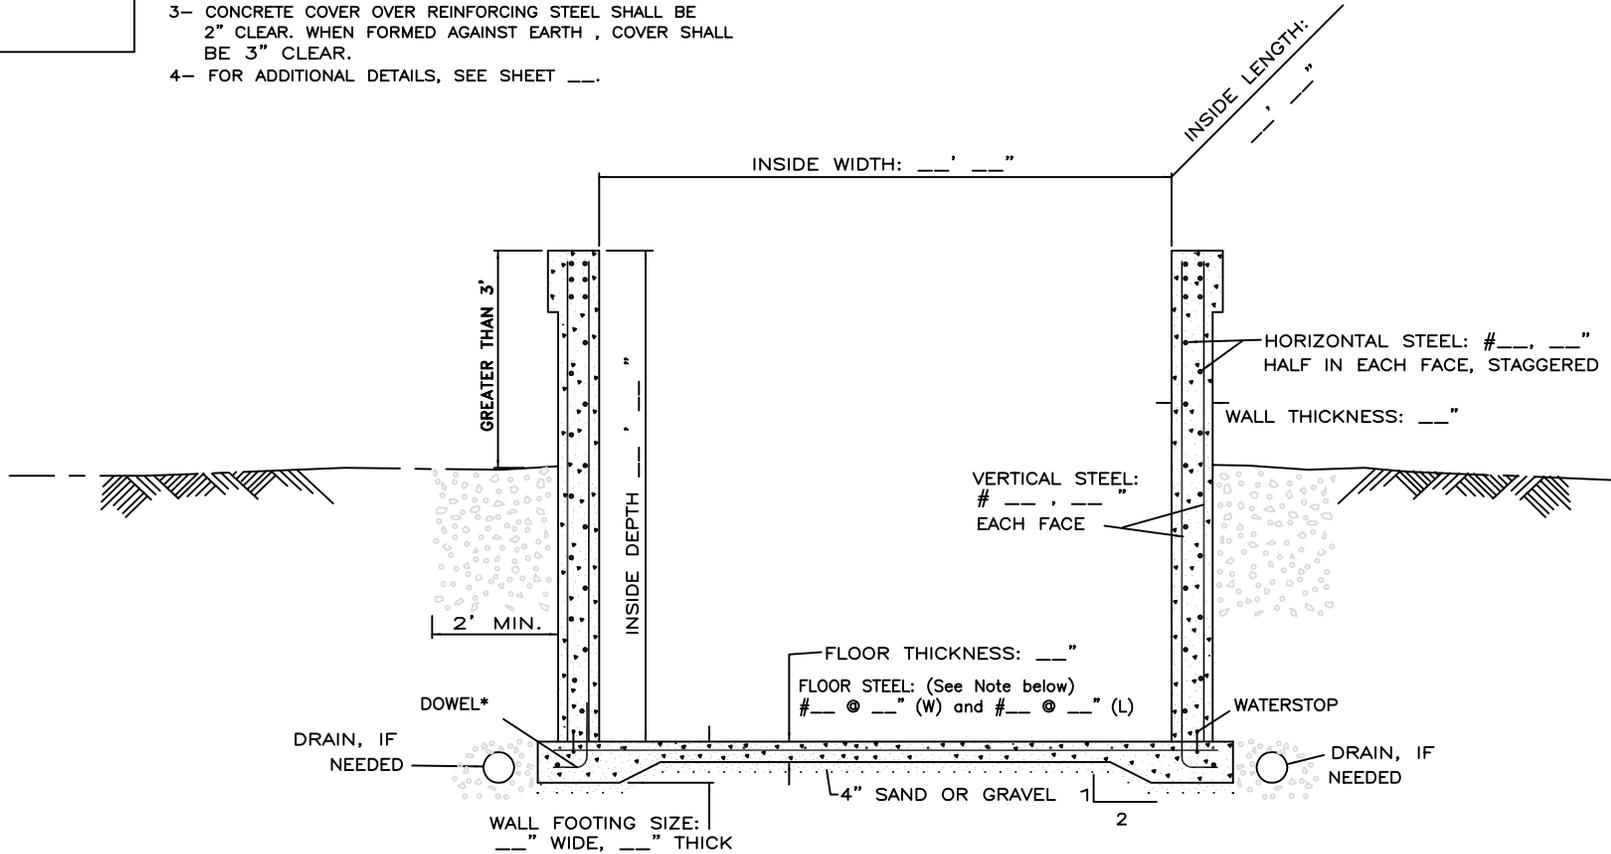

**\* DOWELS (DEFORMED REINFORCING STEEL)**

- OPTION 1: EXTEND 12" OF VERTICAL STEEL INTO FOOTING.  
 EXTEND STEEL VERTICALLY INTO THE FOOTING WITHIN 3" OF FOOTING BOTTOM, THEN BEND 90°.
- OPTION 2: USE A 24" LONG BAR, EQUIVALENT TO THE VERTICAL STEEL.  
 TIE 12" OF THE DOWEL TO THE VERTICAL STEEL.  
 EXTEND VERTICALLY INTO THE FOOTING WITHIN 3" OF FOOTING BOTTOM, THEN BEND 90°.

**FLOOR THICKNESS AND STEEL:**  
 THE FLOOR SLAB THICKNESS AND REINFORCING STEEL REQUIREMENTS SHALL BE AS SPECIFIED IN THE NRCS-OHIO CONSTRUCTION SPECIFICATION "CONCRETE".

NOT TO SCALE

STANDARD DRAWING NO.: DH-N-517-CAD  
 APPROVAL DATE: 7/25/00

REVISIONS:

Date	_____
Designed	_____
Drawn	_____
Checked	_____
Approved	_____

RECTANGULAR TANK WITH OPEN TOP  
 AND  
 GREATER THAN 3 FEET EXTENDED ABOVE GROUND



File No.  
 oh051700.dwg

Drawing No.

Sheet of